


Environmental Services

VILLAGE OF MEDINA WWTF DISCHARGE QUALITY – January 2007

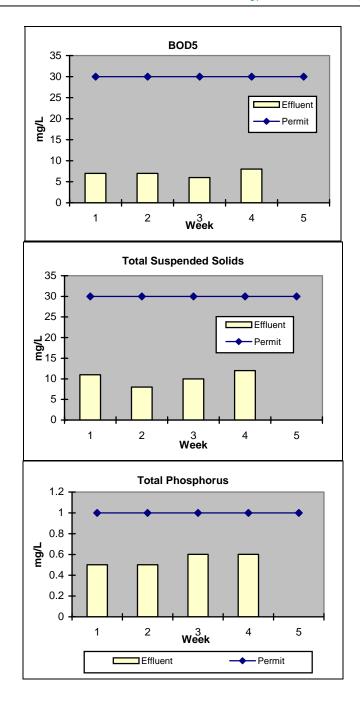

Water is our Business

vRI

Environmental Services

Village Board Village of Medina 600 Main Street Medina, New York 14103

Re: Wastewater Treatment Plant – Facilities Operation Report.

The Village's Facility treated on average 2,249,000 gallons per day in January 2007. New York State Discharge Permit {NYS-SPDES} limits were met over the period. Below are the projects completed and other significant notes. Daily operations/maintenance activities conducted as scheduled.

Projects and significant events of record.

- Composting operation processed 6.403 tons processed.
- Removed 22 cubic feet of grit from influent.
- Greased all equipment.
- Weekly checks of overflow points conducted.
- Gas Compressor removed DPW repaired reinstalled operational.
- Remixed 2 batches of compost for process.
- Tested layering compost with wood chips to prevent excessive heat build up.
- Snow removal.
- Installed rebuilt gas trap on gas compressor.
- Repaired heater over degritters
- Repacked moyno pumps.
- One Primary Clarifier off line Main Chain drive/ride gear sprocket is wore to point of chain slippage. Ordered replacement.
- Belt Filter Press Air Valve repaired.
- Repaired Aggie Truck would not start.

Steven C. Stauffer Regional Manager Valley River Inc.

Millbrook

Water is our Business