


VRI

Water and Wastewater
Specialists

VILLAGE OF MEDINA WWTF DISCHARGE QUALITY – November 2006

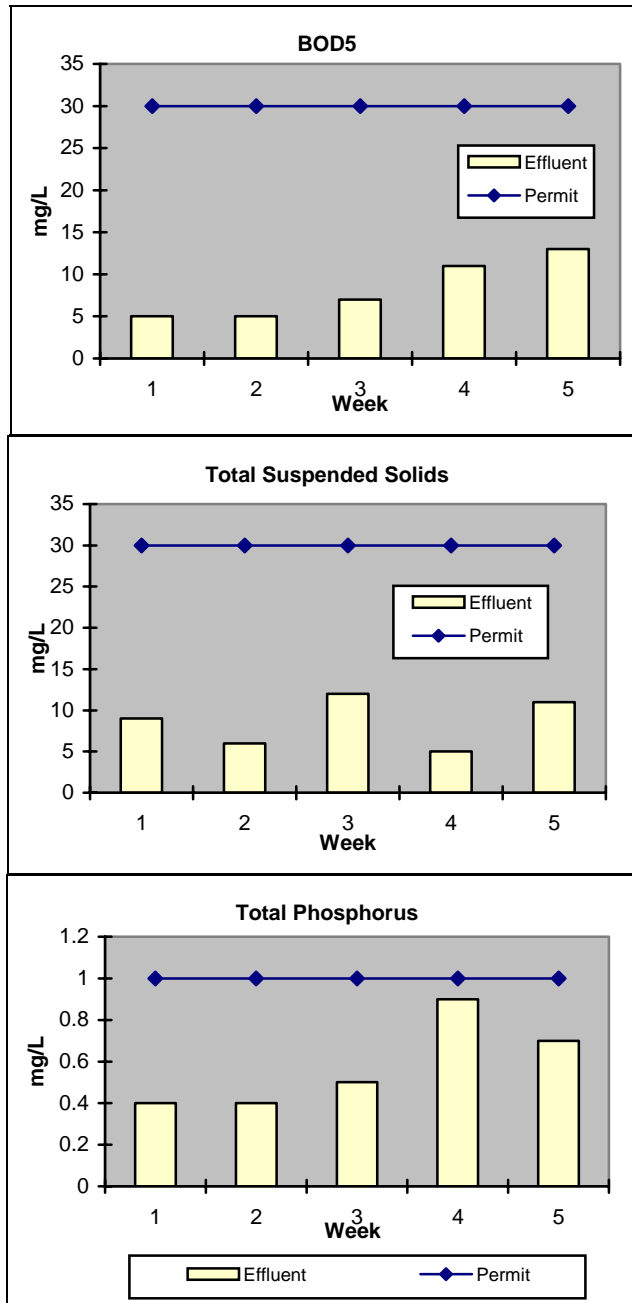

W a t e r i s o u r B u s i n e s s

Valley River, Inc.
P. O. Box 943
Millbrook, New York 12545

www.vri-usa.com

845-677-3839
Toll Free: 800-880-6165
Fax 845-677-3940

Millbrook

Camden

Oakfield



Water and Wastewater
Specialists

Village Board
Village of Medina
600 Main Street
Medina, New York 14103

Re: Wastewater Treatment Plant – Facilities Operation Report.

The Village's Facility treated on average 2,250,000 gallons per day in November. New York State Discharge Permit {NYS-SPDES} limits were met over the period. Below are the projects completed and other significant notes. Daily operations/maintenance activities conducted as scheduled.

Projects and significant events of record.

- Composting operation in process. 9.417 tons processed.
- Removed 12 cubic feet of grit from influent.
- Greased all equipment.
- Cleared blockage in East thickener.
- Completed painting lab counter top.
- Continued lab analysis study.
- Replaced ferric chloride lines.
- Repack moyno pumps.
- Repaired press room over head door.
- Repaired faucet in lab
- Adjusted chains on Aggie truck
- Flushed methane system.
- Replaced bad bearing on one RBC.

Steven C. Stauffer
Regional Manager
Valley River Inc.

W a t e r i s o u r B u s i n e s s

Valley River, Inc.
P. O. Box 943
Millbrook, New York 12545

www.vri-usa.com

845-677-3839
Toll Free: 800-880-6165
Fax 845-677-3940

Millbrook

Camden

Oakfield